
Wireless Activity Detection Sensor

Wireless Activity Detection Sensor User Manual

Copyright©Netvox Technology Co., Ltd.

This document contains proprietary technical information which is the property of NETVOX Technology. It shall be maintained in strict confidence and shall not be disclosed to other parties, in whole or in part, without written permission of NETVOX Technology. The specifications are subject to change without prior notice.

Table of Content

1. Introduction	2
2. Appearance	3
3. Main Features	3
4. Set up Instruction.....	4
5. Data Report.....	5
6. Installation	10
7. Relative Devices.....	11
8. Important Maintenance Instruction	11

1. Introduction

The R313FA is a vibration alarm device for Netvox ClassA type devices based on the LoRaWAN open protocol. When the device detects movement or vibration, it immediately triggers an alarm, compatible with LoRaWAN protocol.

LoRa Wireless Technology:

LoRa is a wireless communication technology dedicated to long distance and low power consumption. Compared with other communication methods, LoRa spread spectrum modulation method greatly increases to expand the communication distance. Widely used in long-distance, low-data wireless communications. For example, automatic meter reading, building automation equipment, wireless security systems, industrial monitoring. Main features include small size, low power consumption, transmission distance, anti-interference ability and so on.

LoRaWAN:

LoRaWAN uses LoRa technology to define end-to-end standard specifications to ensure interoperability between devices and gateways from different manufacturers.

2. Appearance



3. Main Features

- Apply SX1276 wireless communication module
- 2 section 3V CR2450 button battery powered
- Vibration status and battery voltage detection
- Compatible with LoRaWAN™ Class A
- Frequency hopping spread spectrum technology
- Configuration parameters can be configured through third-party software platforms, data can be read and alarms can be set via SMS text and email (optional)
- Available third-party platform: Actility / ThingPark, TTN, MyDevices/Cayenne
- Improved power management for longer battery life

Battery Life:

- Please refer to web: http://www.netvox.com.tw/electric/electric_calc.html
- At this website, users can find battery life time for variety models at different configurations.
 1. Actual range may vary depending on environment.
 2. Battery life is determined by sensor reporting frequency and other variables.

4. Set up Instruction

On/Off

Power on	Insert two sections of 3V CR2450 button batteries and close the battery cover
Turn on	Press any function key and the green and red indicator flash once.
Turn off (Restore to factory setting)	Press and hold both function keys for 5 seconds till the green indicator flashes for 20 times.
Power off	Remove Batteries.
Note:	<ol style="list-style-type: none"> 1. Remove and insert the battery; the device memorizes previous on/off state by default. 2. On/off interval is suggested to be about 10 seconds to avoid the interference of capacitor inductance and other energy storage components. 3. Press any function key and insert batteries at the same time; it will enter engineer testing mode.

Network Joining

Never joined the network	<p>Turn on the device to search the network to join.</p> <p>The green indicator stays on for 5 seconds: success</p> <p>The green indicator remains off: fail</p>
Had joined the network	<p>Turn on the device to search the previous network to join.</p> <p>The green indicator stays on for 5 seconds: success</p> <p>The green indicator remains off: fail</p>
Fail to join the network (when the device is on)	Suggest to check the device verification information on the gateway or consult your platform server provider.

Function Key

Press and hold for 5 seconds	<p>Restore to factory setting / Turn off</p> <p>The green indicator flashes for 20 times: success</p> <p>The green indicator remains off: fail</p>
Press once	<p>The device is in the network: the green indicator flashes once and sends a report</p> <p>The device is not in the network: the green indicator remains off</p>

Sleeping Mode

The device is on and in the network	Sleeping period: Min Interval. When the reportchange exceeds setting value or the state changes: send a data report according to Min Interval.
-------------------------------------	---

Low Voltage Warning

Low Voltage	2.4V
-------------	------

5. Data Report

The device will immediately send a version packet report along with an uplink packet including vibration status and battery voltage.

The device sends data in the default configuration before any configuration is done.

Default setting:

MaxTime: Max Interval = 60 min = 3600s

MinTime: Min Interval = 60 min = 3600s

BatteryChange: 0x01 (0.1V)

ActiveThreshold: 0x0003 (Threshold range: 0x0003-0x00FF, 0x03 is the most sensitive)

Deactivetime: 0x05 (Deactive time Range: 0x01-0xFF)

ActiveThreshold:

$Active\ Threshold = Critical\ value \div 9.8 \div 0.0625$

*The gravitational acceleration at standard atmospheric pressure is 9.8 m/s²

*The scale factor of the threshold is 62.5 mg

R313FA vibration alarm:

The device detects a sudden movement or vibration, change of the quiescent state, and it will immediately send a report. After the vibration alarm, the device waits for DeactiveTime to enter the quiescent state before starting the next detection. If the vibration continues to occur during this process, the timing restarts until it enters the quiescent state.

R313FX Series DeviceType:

R313FA 0x01; R313FB 0x02; R313FC 0x03

Note:

The device report interval will be programmed based on the default firmware which may vary.

The interval between two reports must be the minimum time.

Please refer Netvox *LoRaWAN Application Command document* and *Netvox Lora Command Resolver*

<http://www.netvox.com.cn:8888/cmddoc> to resolve uplink data.

Data report configuration and sending period are as following:

Min Interval (Unit: second)	Max Interval (Unit: second)	Reportable Change	Current Change ≥ Reportable Change	Current Change < Reportable Change
Any number between 1~65535	Any number between 1~65535	Can not be 0.	Report per Min Interval	Report per Max Interval

Example of data configuration:

FPort: 0x07

Bytes	1	1	Var(Fix =9 Bytes)
	CmdID	DeviceType	NetvoxPayloadData

CmdID– 1 byte

DeviceType– 1 byte – Device Type of Device

NetvoxPayloadData– var bytes (Max=9bytes)

Description	Device	Cmd ID	DeviceT ype	NetvoxPayloadData			
Config ReportReq	R313FA	0x01	0x4F	MinTime (2bytes Unit:s)	MaxTime (2bytes Unit:s)	BatteryChange (1byte Unit:0.1v)	Reserved (4Bytes,Fixed 0x00)
Config ReportRsp		0x81		Status (0x00 _success)		Reserved (8Bytes,Fixed 0x00)	
ReadConfig ReportReq		0x02		Reserved (9Bytes,Fixed 0x00)			
ReadConfig ReportRsp		0x82		MinTime (2bytes Unit:s)	MaxTime (2bytes Unit:s)	BatteryChange (1byte Unit:0.1v)	Reserved (4Bytes,Fixed 0x00)

(1) Configure device parameters MinTime = 1min, MaxTime = 1min, BatteryChange = 0.1v

Downlink: 014F003C003C0100000000

The device returns:

814F00000000000000000000 (configuration succeeded)

814F01000000000000000000 (configuration failed)

(2) Read device configuration parameters

Downlink: 024F00000000000000000000

The device returns:

824F003C003C0100000000 (current device configuration parameters)

Description	Device	Cmd ID	DeviceType	NetvoxPayloadData			
SetR313FTypeReq	R313FA	0x03	0x4F	R313FType (1Bytes,0x01_R313FA,0x02_R313FB,0x03_R313FC)		Reserved (8Bytes,Fixed 0x00)	
SetR313FTypeRsp		0x83		Status (0x00_success)	Reserved (8Bytes,Fixed 0x00)		
GetR313FTypeReq		0x04		Reserved (9Bytes,Fixed 0x00)			
GetR313FTypeRsp		0x84		R313FType (1Bytes,0x01_R313FA,0x02_R313FB,0x03_R313FC)		Reserved (8Bytes,Fixed 0x00)	
SetActiveThresholdReq		0x05		Threshold (2Bytes)	Deactivetime (1Byte,Unit:1s)	Reserved (6Bytes,Fixed 0x00)	
SetActiveThresholdRsp		0x85		Status (0x00_success)		Reserved (8Bytes,Fixed 0x00)	
GetActiveThresholdReq		0x06		Reserved (9Bytes,Fixed 0x00)			
GetActiveThresholdRsp		0x86		Threshold (2Bytes)	Deactivetime (1Byte,Unit:1s)	Reserved (6Bytes,Fixed 0x00)	

(3) Change the device type to R313FB (0x02)

Downlink: 034F02000000000000000000

The device returns:

834F00000000000000000000 (configuration succeeded)

834F01000000000000000000 (configuration failed)

(4) Check the current device type


Downlink: 044F00000000000000000000

The device returns:

844F02000000000000000000 (current device type R313FB)

Example for MinTime/MaxTime logic:


Example#1 based on MinTime = 1 Hour, MaxTime= 1 Hour, Reportable Change i.e. BatteryVoltageChange=0.1V

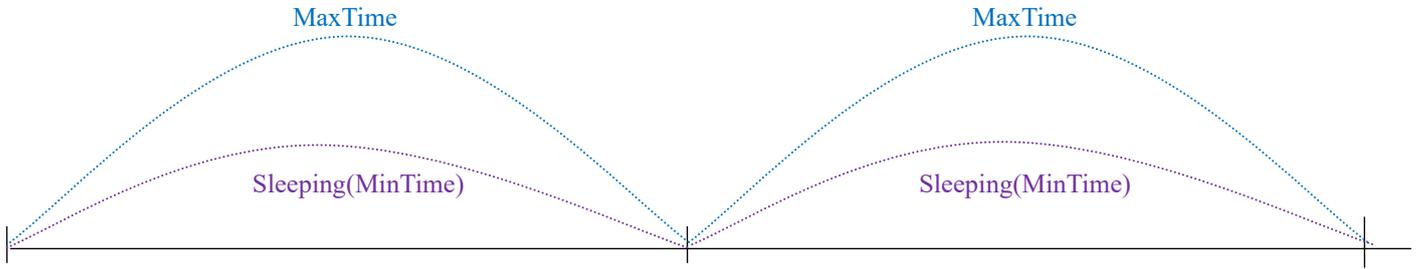

Wakes up and collects data REPORTS 2.8V Wakes up and collects data REPORTS 2.8V Wake up and collects data REPORTS 2.8V


Note:
MaxTime=MinTime. Data will only be report according to MaxTime (MinTime) duration regardless BtteryVoltageChange value.

Example#2 based on MinTime = 15 Minutes, MaxTime= 1 Hour, Reportable Change i.e. BatteryVoltageChange= 0.1V.

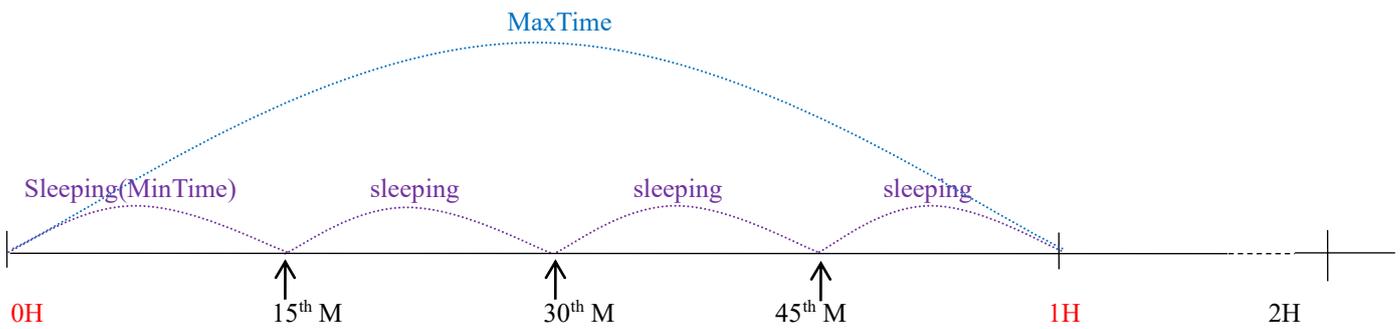

0H	15 th M	30 th M	45 th M	1H	2H
Wakes up and collects data REPORT 2.8V	Wakes up and collects data 2.8V Does not report	Wakes up and collects data 2.8V Does not report	Wakes up and collects data 2.8V Does not report	Wakes up and collects data REPORT 2.8V	

Example#3 based on MinTime = 15 Minutes, MaxTime= 1 Hour, Reportable Change i.e. BatteryVoltageChange= 0.1V.

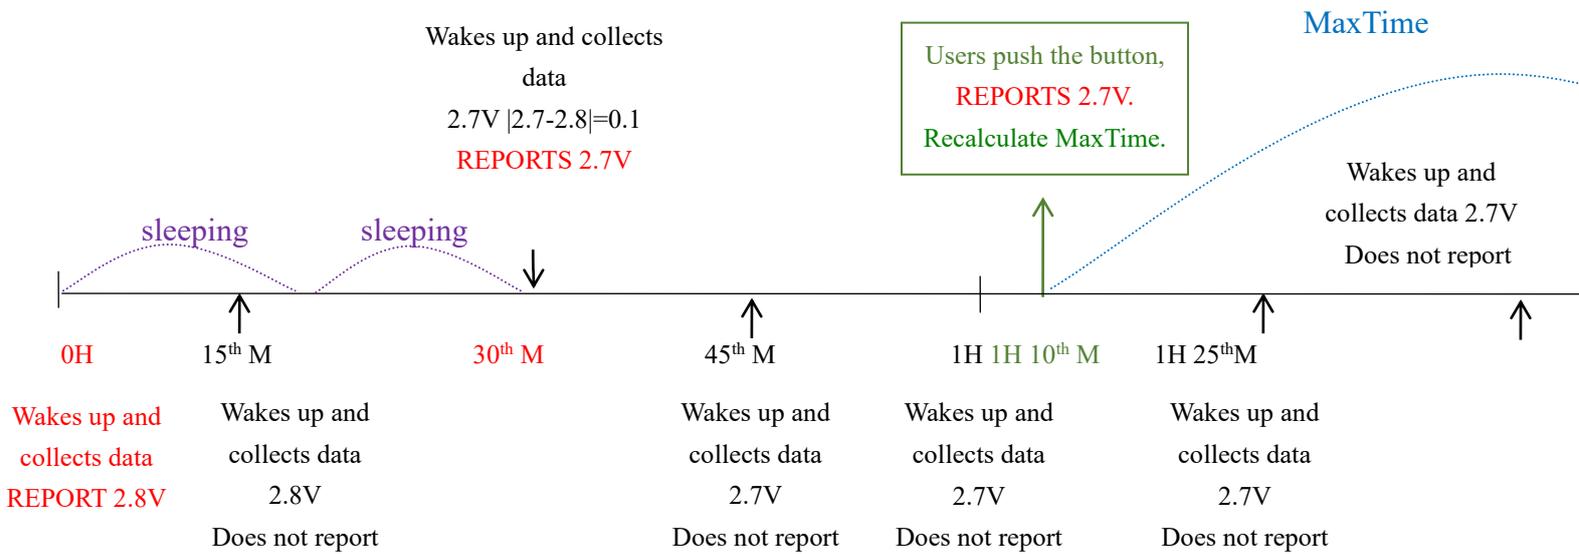

Notes:

- (1) The device only wakes up and performs data sampling according to MinTime Interval. When it is sleeping, it does not collect data.
- (2) The data collected is compared with the last data reported. If the data change value is greater than the ReportableChange value, the device reports according to MinTime interval.
If the data variation is not greater than the last data reported, the device reports according to MaxTime interval.
- (3) We do not recommend to set the MinTime Interval value too low. If the MinTime Interval is too low, the device wakes up frequently and the battery will be drained soon.
- (4) Whenever the device sends a report, no matter resulting from data variation, button pushed or MaxTime interval, another cycle of MinTime/MaxTime calculation is started.

6. Installation

1. Remove the 3M adhesive on the back of the Activity Detection Sensor and attach the body to the surface of a smooth object (please do not stick it to a rough surface to prevent the device from falling off after a long time use).

Note:

- Wipe the surface clean before installation to avoid dust on the surface to affect the adhesion of the device.
- Do not install the device in a metal shielded box or other electrical equipment around it to avoid affecting the wireless transmission of the device.



Activity Detection Sensor (R313FA) is suitable for the following scenarios:

- Valuables (Painting, Safe)
- Industrial Equipment
- Industrial Instrument
- Medical Instruments

When it necessary to detect a possibility of the valuables are moved and the motor running.



2. The device detects a sudden movement or vibration, and it will immediately sends a report.

After the vibration alarm, the device waits for a certain period of time (DeactiveTime- default : 5 seconds, can be modified) to enter the quiescent state before starting the next detection.

Note:

- If the vibration continues to occur during this process (quiescent state), then it will delay 5 seconds until it enters the quiescent state.
- When the vibration alarm is generated, the alarm bit of the data is "1", quiescent state bit of the data is "0"



7. Relative Devices

Model	Function	Appearance
R718MBA	Send an alarm when detecting vibration or movement	
R718MBB	Count the number of vibration or movement	
R718MBC	Count the time interval of vibration or movement	

8. Important Maintenance Instruction

Kindly pay attention to the following in order to achieve the best maintenance of the product:

- Keep the device dry. Rain, moisture, or any liquid, might contain minerals and thus corrode electronic circuits. If the device gets wet, please dry it completely.
- Do not use or store the device in dusty or dirty environment. It might damage its detachable parts and electronic components.
- Do not store the device under excessive heat condition. High temperature can shorten the life of electronic devices, destroy batteries, and deform or melt some plastic parts.
- Do not store the device in places that are too cold. Otherwise, when the temperature rises to normal temperature, moisture will form inside, which will destroy the board.
- Do not throw, knock or shake the device. Rough handling of equipment can destroy internal circuit boards and delicate structures.
- Do not clean the device with strong chemicals, detergents or strong detergents.
- Do not apply the device with paint. Smudges might block in the device and affect the operation.
- Do not throw the battery into the fire, or the battery will explode. Damaged batteries may also explode.

All of the above applies to your device, battery and accessories. If any device is not working properly, please take it to the nearest authorized service facility for repair.